

# Inspection Checklist

<b>Address:</b>	<b>Approval ID:</b>	<b>AHJ:</b> Apple Valley, CA	<b>Scope of work:</b>	PV Residential Roof Mount 11.200KW, 32 modules & 1 inverter
-----------------	---------------------	---------------------------------	-----------------------	---

Interconnection at Main Service Panel			Pass
Single Phase Grid Voltage: INPUT Volts	240 V		<input type="checkbox"/>
System Point of Interconnection Compliance Method At Main Service Panel: 705.12 (B) (2) (3) (b), 120% Rule Where two sources, one a primary power source and the other another power source, are located at opposite ends of a busbar that contains loads, the sum of 125 percent of the power source(s) output circuit current and the rating of the overcurrent device protecting the busbar shall not exceed 120 percent of the ampacity of the busbar.			<input type="checkbox"/>
Backfeed breakers are at opposite load ends of the panel.			<input type="checkbox"/>

SAMPLE

Main Service Panel Equipment			Pass
Main Breaker Ampere Rating Size: INPUT AMP	200 AMP		<input type="checkbox"/>
Main Bus Ampere Rating Size: INPUT AMP	200 AMP		<input type="checkbox"/>
Utility Service Rating: INPUT	200		<input type="checkbox"/>
The equipment is connected either directly to the main service panel or in a Supply Side Connection.			<input type="checkbox"/>
If grounding electrode is rod, pipe or plate, then supplemental electrode is properly installed. Exception: If a single rod, pipe, or plate grounding electrode has a resistance to earth of 25 ohms or less, the supplemental electrode shall not be required.			<input type="checkbox"/>
EGC is installed ensuring continuity to all system components and finally to grounding electrode.			<input type="checkbox"/>

Equipment Point of Interconnection			Pass
All power production inverter outputs have the same point of connection.			<input type="checkbox"/>
Connected equipment is within line of sight and closer than 10ft to the point of interconnection or a disconnect/isolation means are installed.			<input type="checkbox"/>
There is no existing Utility interactive power production source connected to the home's electric service. - Only the utility interactive power production sources and/or photovoltaic modules specified on this inspection checklist list are present on site.			<input type="checkbox"/>
DC and AC conductors are copper, Class B or Class C, and THWN-2, NM or PV Wire, or they are a jacketed multiconductor cable assembly listed and identified for the application.			<input type="checkbox"/>
All power terminals are rated to 75°C or greater, labeled for use with Copper Class B or Class C wires, and accept minimum 8 AWG wire.			<input type="checkbox"/>
Conductors are properly terminated and wired according to the code.			<input type="checkbox"/>
Where Equipment Grounding Conductors (EGC) are not routed with circuit conductors, EGC is a minimum of 6 AWG or it's protected from physical damage			<input type="checkbox"/>
There is a minimum of 3' working clearance, according to the code, for all components that may require service.			<input type="checkbox"/>

Inverter		Pass
Inverter architecture:	String Inverter with DC-DC Converters	<input type="checkbox"/>
EGC Wire Size Inverter 1: INPUT	10 AWG	<input type="checkbox"/>
Overcurrent Protective Device rating: Inverter 1	60 AMP	<input type="checkbox"/>
AC Wire size Inverter 1: INPUT	6 AWG	<input type="checkbox"/>
Maximum number of THWN-2 conductors in an PV inverter AC output circuit raceway, excluding any equipment grounding conductors.	4	<input type="checkbox"/>
Inverter 1 model number: INPUT	SE7600H-US [240V]	<input type="checkbox"/>
Inverter 1 manufacturer: INPUT	SolarEdge Technologies Ltd.	<input type="checkbox"/>
Maximum number of THWN-2 DC conductors in raceway, excluding any equipment grounding conductors.	4 wires	<input type="checkbox"/>
Maximum number of DC PV wire or USE-2 conductors in raceway, excluding any equipment grounding conductors.	0 wires	<input type="checkbox"/>
Minimum DC Wire Gauge (THWN-2 Wire):	12 AWG	<input type="checkbox"/>
DC strings EGC is a minimum of 10 AWG		<input type="checkbox"/>
Presence of Rapid Shutdown switch label per Fire Bulletin		<input type="checkbox"/>

Installation Details		Pass
Conduit sizing to be confirmed at time of inspection. Contractor to provide conduit fill calculations where requested by inspector		<input type="checkbox"/>

Roof and PV Array		Pass
Racking system model number is on list of approved modules to 2703 for grounding and bonding.		<input type="checkbox"/>
Attachment points of the mounting system be staggered: INPUT	No	<input type="checkbox"/>
Maximum spacing in inches between adjacent attachment points of the mounting system INPUT	48"	<input type="checkbox"/>
Roof penetration sealant method has been installed per the manufacturers instructions.		<input type="checkbox"/>
The roof structure appears to be structurally sound, without signs of alterations or significant structural deterioration or sagging.		<input type="checkbox"/>
Quantity and spacing of structural attachments match the installation instructions per manufacturer.		<input type="checkbox"/>
Array conductors are secured and supported. Installed so as not to damage the cable, at intervals not exceeding 1.4 m (4.6 ft) and within 300 mm (12 in.) of every cable entry into enclosures such as outlet boxes, junction boxes, cabinets, or fittings.		<input type="checkbox"/>
Module 1 model number: INPUT	LR4-60HPB-350M	<input type="checkbox"/>
Module 1 manufacturer: INPUT	LONGi Green Energy Technology Co., Ltd.	<input type="checkbox"/>
Module 1 quantity: INPUT	32	<input type="checkbox"/>
Method of rapid shutdown compliance Inside the Array	AC module, microinverter,	<input type="checkbox"/>

Roof and PV Array		Pass
	or DCDC converter installed on each module and listed for UL 1741 or UL 3741 as PVRSS or PVRSE used to comply with requirements for Rapid Shutdown.	<input type="checkbox"/>
All rooftop conduits are mounted at least 7/8" above the roof surface.		<input type="checkbox"/>
All PV Source Circuit conductors installed without raceway are listed as PV Wire or USE-2.		<input type="checkbox"/>

Roof and PV Array 1		Pass
Plane 1 Roof Covering: INPUT	Clay and concrete tile	<input type="checkbox"/>
The height of the modules, from roof 1 surface to the module backsheet, does not exceed 10"		<input type="checkbox"/>

Roof and PV Array 2		Pass
Plane 2 Roof Covering: INPUT	Clay and concrete tile	<input type="checkbox"/>
The height of the modules, from roof 2 surface to the module backsheet, does not exceed 10"		<input type="checkbox"/>

Roof and PV Array 3		Pass
Plane 3 Roof Covering: INPUT	Clay and concrete tile	<input type="checkbox"/>
The height of the modules, from roof 3 surface to the module backsheet, does not exceed 10"		<input type="checkbox"/>

Roof and PV Array 4		Pass
Plane 4 Roof Covering: INPUT	Clay and concrete tile	<input type="checkbox"/>
The height of the modules, from roof 4 surface to the module backsheet, does not exceed 10"		<input type="checkbox"/>

Roof and PV Array 5		Pass
Plane 5 Roof Covering: INPUT	Clay and concrete tile	<input type="checkbox"/>
The height of the modules, from roof 5 surface to the module backsheet, does not exceed 10"		<input type="checkbox"/>

Fire		Pass
% of the Roof with a Solar Array INPUT	24.49%	<input type="checkbox"/>
Fire Pathways, venting and access in accordance with INPUT	Less Than 33/66	<input type="checkbox"/>
Disconnecting Means are in compliance with the SolarAPP Fire Bulletin		<input type="checkbox"/>
Signage, Placards, Directories and Markings in accordance with the SolarAPP Fire Bulletin		<input type="checkbox"/>
Maximum AC operating current in labels	31.73 A	<input type="checkbox"/>
Maximum AC operating voltage in labels	240 V	<input type="checkbox"/>

**Corrections**

---

---

---

---

---

SAMPLE

# FIRE SAFETY CODE REQUIREMENTS

Does the home have sprinkler systems?

No

% of Roof Area covered with PV = Total Array Area/Total Roof Area:  $\frac{\{C17\}}{\{I102\}} = \{C15\}$


24.49%

## Roof Access and Ventilation Diagrams

Fire Safety

### Ridge Setbacks

PV Less Than 33% Roof Area (66% for homes with sprinkler systems)




### Emergency Escape & Rescue Opening

Minimum 3' Emergency Escape Pathway




### Hips and Valley Setbacks

PV Less Than 33% Roof Area - Street Access (66% for homes with sprinkler systems)

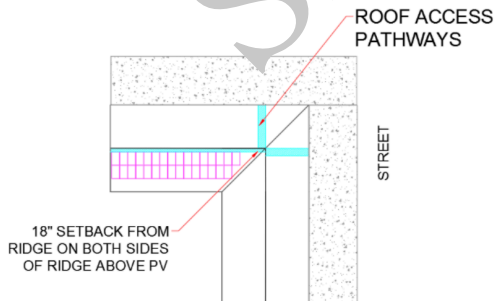

PV Less Than 33% Roof Area - Driveway Access (66% for homes with sprinkler systems)

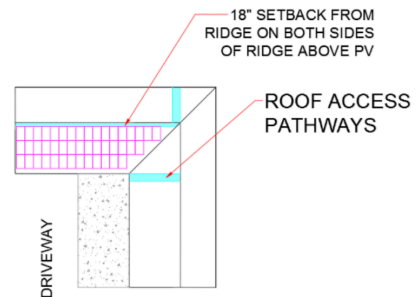

# SolarAPP Fire Bulletin

## Disconnecting Means

SolarAPP Fire Bulletin

### PV System

PV system disconnecting means shall be provided in accordance with the 2017 National Electrical Code® (NEC), NFPA 70®. [690.13]

A Rapid Shutdown switch shall be provided at a readily accessible location outside the building in accordance with the 2017 National Electrical Code® (NEC), NFPA 70® [690.12(C)]

## Signs, Placards, Directories and Markings Guidance

SolarAPP Fire Bulletin

### General

All labeling shall comply with Section 324 of the 2021 International Residential Code and Articles 690 and 705 of the 2017 National Electrical Code® (NEC), NFPA 70

All labeling shall comply with [NEC 110.21 (B)]

### Rapid Shutdown Label

A label shall be installed not greater than 3ft from the electric utility service location that includes the location of all identified Rapid Shutdown switches if not at the same location. [IRC 324]

The label shall indicate which type of Rapid Shutdown system is installed, and include a simple diagram with sections in red designating areas that are not controlled by the rapid shutdown switch. [NEC 690.56(C)(1)]

Buildings with more than one rapid shutdown type:

A detailed plan view diagram showing each PV system and a dotted line around areas that remain energized after the rapid shutdown switch is operated. [NEC 690.56(C)(2)]

## Rapid Shutdown Label (continued)

Rapid Shutdown (PV Hazard Control) switch:

This switch shall have a label not greater than 3 feet from the switch that states the following: RAPID SHUTDOWN SWITCH FOR SOLAR PV SYSTEM" [NEC 690.56(C)(3)]

## Roof Access, Egress, and Ventilation

SolarAPP Fire Bulletin

### General

Access and minimum spacing shall be provided for access to specific areas of the roof, emergency egress from the roof and opportunities for smoke ventilation in accordance with the 2021 International Residential Code [IRC 324.6]

### References

Ridge Setbacks - [IRC R324.6.2]

Sprinklered Occupancies - [IRC R324.6.2.1]

Pathways - [IRC 324.6.1]

Emergency escape and rescue openings - [IRC R324.6.3]

### Exceptions

Detached, non-inhabitable structures [IRC R324.6 Ex. 1]

Low-slope roofs with pitch of less than or equal to 2:12; this exception may not be valid depending on the jurisdiction. [IRC R324.6 Ex. 3]

BIPV systems listed in accordance with Section 690.12(B)(2) of NFPA 70, where the removal or cutting away of portions of the BIPV system during fire-fighting operations has been determined to not expose a fire fighter to electrical shock hazards. [IRC R324.6 Ex. 4]

## Carbon Monoxide and Smoke Detectors

SolarAPP Fire Bulletin

### Guidance

Carbon Monoxide and smoke detectors shall be provided in accordance with the code or an Affidavit has been provided by the customer. 2021 International Residential Code.

[R314, R315]

## Guidance (continued)

Rooms and areas within dwelling units, basements and attached garages in which ESS are installed shall be protected by smoke alarms in accordance to the code. A heat detector, listed and interconnected to the smoke alarms, shall be installed in locations within dwelling units and attached garages where smoke alarms cannot be installed based on their listing. 2021 International Residential Code. [R314, R315]

## Fire Classification

SolarAPP Fire Bulletin

### PV System

Rooftop-mounted PV systems shall have the same fire classification as the roof assembly required in 2021 International Residential Code. [R902.4; R324.4.2]

Building-integrated photovoltaic products installed as the roof covering shall be tested, listed, and labeled for fire classification. [IRC 902.3]

Building-integrated photovoltaic products installed as the roof covering shall comply with the minimum requirements for fire classification set by the jurisdiction. [IRC 902.1]

## Product Certifications

SolarAPP Fire Bulletin

### PV System

PV panels and modules shall be listed and labeled to UL 1703 and/or both UL 61730-1 and UL 61730-2 [NEC 690.4(B)][IRC R324.3.1]

Inverters shall be listed and labeled to UL 1741 [NEC 690.4(B)][IRC R324.3.1]

### Hazard Control System

Hazard control system shall be listed and labeled to UL 3741 [NEC 90.7; 110.3(C); 690.4(B) 690.12(D)]



## Service Disconnect

**SOLAR PV SYSTEM IS EQUIPPED WITH RAPID SHUTDOWN**

TURN RAPID SHUTDOWN SWITCH TO THE "OFF" POSITION TO SHUT DOWN CONDUCTORS OUTSIDE THE ARRAY. CONDUCTORS IN ARRAY REMAIN ENERGIZED IN SUNLIGHT

SIMPLE DIAGRAM HERE

**Location:**

Location: No more than 1 m (3 ft) away from the service disconnecting means. [NEC 690.56(C)(1)(a)]

## RSD Initiation Device

**RAPID SHUTDOWN SWITCH FOR SOLAR PV SYSTEM**

**Location:**

Rapid shutdown initiation device. [NEC 690.56(C)(3)]

## Point of Interconnection

**WARNING:**  
EQUIPMENT FED BY MULTIPLE SOURCES LOCATION OF DISCONNECTING MEANS

(LAYOUT OR DESCRIPTION)

**Location:**

At each service equipment location and at the location(s) of the system disconnect(s) for all electric power production sources capable of being interconnected." [NEC 705.10]

**WARNING:**  
DUAL POWER SOURCE SECOND SOURCE IS PV SYSTEM

**Location:**

Electrical Equipment containing overcurrent devices in circuits supplying power to a busbar or conductor supplied from multiple sources [NEC 705.12(B)(3)]

**WARNING:**  
POWER SOURCE OUTPUT CONNECTION - DO NOT RELOCATE THIS OVERCURRENT DEVICE

**Location:**

At back-feed breaker if using 120% rule (if applicable) [NEC 705.12(B)(2)(3)(b)]

**WARNING:**  
THIS EQUIPMENT FED BY MULTIPLE SOURCES. TOTAL RATING OF ALL OVERCURRENT DEVICES EXCLUDING MAIN SUPPLY OVERCURRENT DEVICE, SHALL NOT EXCEED AMPACITY OF BUSBAR

**Location:**

At distribution equipment adjacent to the back-fed breaker from the power source when using this "sum of breakers" code compliance rule. [NEC 705.12(B)(2)(3)(c)]

**PHOTOVOLTAIC POINT OF INTERCONNECTION**

MAXIMUM AC OPERATING CURRENT:

MAXIMUM AC OPERATING VOLTAGE:

**Location:**

All interactive system(s) points of interconnection. [NEC 690.54]

## DC Circuit Raceways and Enclosures

PHOTOVOLTAIC POWER SOURCE

**Location:**  
DC Circuit Raceways and Enclosures, conduit, and combiner/junction boxes.  
[NEC 690.31(G)(3)]

## PV System Disconnect

**WARNING:**  
ELECTRIC SHOCK HAZARD TERMINALS ON LINE AND  
LOAD SIDES MAY BE ENERGIZED IN THE OPEN  
POSITION

**Location:**  
DC Disconnecting Means where terminals on both line and load side may  
remain energized. Example language or equivalent. [NEC 690.13(B)]

PV SYSTEM DISCONNECT

**Location:**  
Each PV System Disconnect (May be AC or DC) [NEC 690.13(B)]

## DC String Inverters Equipment Disconnects

**WARNING:**  
ELECTRIC SHOCK HAZARD TERMINALS ON THE LINE  
AND LOAD SIDES MAY BE ENERGIZED IN THE OPEN  
POSITION

**Location:**  
Each PV system disconnecting means where line and load may be energized  
in the open position. [NEC 690.13(B)]

PHOTOVOLTAIC DC DISCONNECT

**Location:**  
Location: Each PV system disconnecting means. [NEC 690.13(B)]

Maximum Voltage:

Maximum Circuit Current:

Maximum rated output current of the charge  
controller or dc-to-dc converter (if installed):

**Location:**  
At each DC PV system disconnecting means. [NEC 690.53]

# FIRE SAFETY CODE REQUIREMENTS

## Roof Access and Ventilation Diagrams

Fire Safety


The following setbacks will be applicable to your PV system if either of the following statements are true:

Your PV Array coverage is less than 66% of the Roof Area and you have a sprinkler system.

Your PV Array coverage is less than 33% of the Roof Area and you do not have a sprinkler system.

### Ridge Setbacks

PV Less Than 33% Roof Area (66% for homes with sprinkler systems) [IRC R324.6.2]




### Emergency Escape & Rescue Opening

Minimum 3' Emergency Escape Pathway [IRC R324.6.2.2]




### Hips and Valley Setbacks

PV Less Than 33% Roof Area - Street Access (66% for homes with sprinkler systems) [IRC R324.6.1]

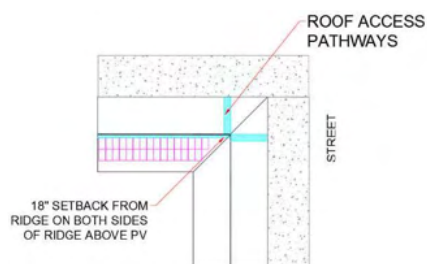

PV Less Than 33% Roof Area - Driveway Access (66% for homes with sprinkler systems) [IRC R324.6.1]

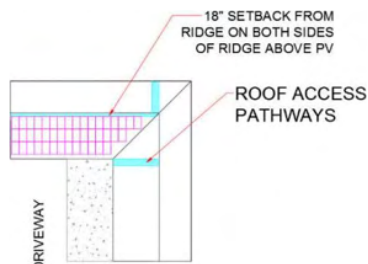

# FIRE SAFETY CODE REQUIREMENTS

## Roof Access and Ventilation Diagrams

Fire Safety


The following setbacks will be applicable to your PV system if either of the following statements are true:

Your PV Array coverage is greater than 66% of the Roof Area and you have a sprinkler system.

Your PV Array coverage is greater than 33% of the Roof Area and you do not have a sprinkler system.

### Ridge Setbacks

PV More Than 33% Roof Area (66% for homes with sprinkler systems) [IRC R324.6.2.1]

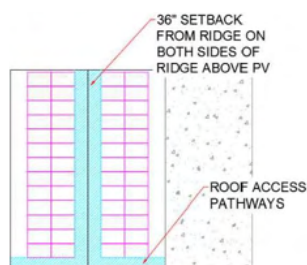


### Emergency Escape & Rescue Opening

Minimum 3' Emergency Escape Pathway [IRC R324.6.3]




### Hips and Valley Setbacks

PV More Than 33% Roof Area - Street Access (66% for homes with sprinkler systems) [IRC R324.6.1]

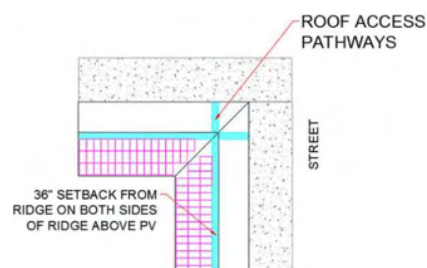

PV More Than 33% Roof Area - Driveway Access (66% for homes with sprinkler systems) [IRC R324.6.1]

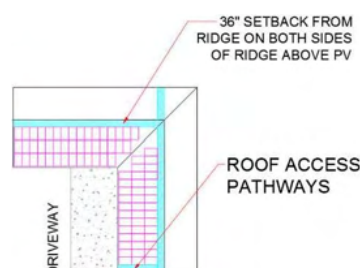

# INPUTS

Permit Details [80.19(H) ; R105.3]

## GENERAL

### Project Information

Project Title	
Address	
AHJ	
Project Type	PV
Scope of Work	PV Residential Roof Mount 11.200KW, 32 modules & 1 inverter
PV System Size AC (kW):	7.616 kW
Confirm you have reviewed SolarAPP eligibility:	Yes

### Contractor Information

Installation Applicability and Compliance	
All work will comply with the 2017 National Electrical Code® (NFPA 70), the International Code Council 2021 I-Codes, Minimum Design Loads and Associated Criteria for Buildings and Other Structures (ASCE/SEI 7-16), UL Standards, Manufacturer's instructions, and Municipal requirements.	
State License	
Type	state
Number	1029644

## City Business License

Type	city
Number	37087

## FIRE

Does the home have sprinkler systems? INPUT	No
What is the total array area? $\{I20\} \rightarrow (\{CEC:L\} * \{I11\} = \{C16\})$ square meters $\{C16\} * (10.764) = \{C17\}$ square feet	609.67 sqft
The total roof area: INPUT	2489 sqft
% of Roof Area covered with PV = $\text{Total Array Area} / \text{Total Roof Area} = \{C17\} / \{I102\} = \{C15\}$	24.49%
See INPUT Fire Setback Diagram attached.	Less Than 33/66

## STRUCTURAL DETAILS

### General

The weight of the PV system in lbs/sq ft: INPUT	2.77 psf
The ground snow load is INPUT	0 lb/sqft
Proposed maximum spacing in inches between adjacent attachment points of the mounting system INPUT	48"

Will attachment points of the mounting system be staggered? INPUT	No
The number of roof surfaces at different slopes and/or orientations that will be used for installation are: INPUT. Note: 1 means all roofs used have the same orientation.	5
Type of mounting for the PV system	Flush mount

**Mounting Planes**

<b>Mounting Plane Type 1</b>	
The maximum height of the module above the roof surface is INPUT inches	5"
The current roof covering is INPUT	Clay and concrete tile
The pitch of the roof surface is INPUT	5/12

<b>Mounting Plane Type 2</b>	
The maximum height of the module above the roof surface is INPUT inches	5"
The current roof covering is INPUT	Clay and concrete tile
The pitch of the roof surface is INPUT	5/12

<b>Mounting Plane Type 3</b>	
The maximum height of the module above the roof surface is INPUT inches	5"
The current roof covering is INPUT	Clay and concrete tile
The pitch of the roof surface is INPUT	5/12

### Mounting Plane Type 4

The maximum height of the module above the roof surface is INPUT inches

5"

The current roof covering is INPUT

Clay and concrete tile

The pitch of the roof surface is INPUT

5/12

### Mounting Plane Type 5

The maximum height of the module above the roof surface is INPUT inches

5"

The current roof covering is INPUT

Clay and concrete tile

The pitch of the roof surface is INPUT

5/12

### Wind Speed

Is the solar module and mounting system rated by the manufacturer to withstand the upward force of the local wind speed and evenly distribute load into the supporting structure at the proposed maximum spacing, and confirmed in UL 1703 or 61730 (Part 1 & 2), and 2703 listings?

Yes, 110 MPH

### Roof Condition

Does the roof structure appear to be structurally sound, without signs of alterations or significant structural deterioration or sagging? YES

Yes

## ELECTRICAL DETAILS

### Equipment



Architecture type used for all inverters in this project:

*String Inverter with DC-DC Converters*

#### Inverter 1

Inverter 1 Model Number: INPUT

*SE7600H-US [240V]*

Datasheet for Inverter 1 [90.7 ; 110.3(C) ; R106.1]: See attached.

*1622137111425-I9-SE7600\_SPE  
C\_SHEET.pdf*

Inverter 1 Manufacturer: INPUT

*SolarEdge Technologies Ltd.*

Is Inverter 1 UL 1741 listed? [110.3(C) ; 690.4(B) ; R324.3.1] YES

Yes

#### Modules

Module 1 Model Number: INPUT

*LR4-60HPB-350M*

Datasheet for Module 1 [90.7 ; 110.3(C) ; R106.1]: See attached.

*1627401243434-I12-LONG\_SOL  
AR\_LR4\_60HPB\_350M.pdf*

Module 1 Manufacturer: INPUT

*LONGi Green Energy Technology  
Co., Ltd.*

Is Module 1 UL 1703 or UL 61730 (Part 1 & 2) listed? [110.3(C) ; 690.4(B) ; R324.3.1] YES

Yes

Module 1 quantity: INPUT

32

Module open circuit voltage with record low temperature correction

42.98 V

Module short circuit current with average high temperature correction

11.24 A

## Racking System 1/Flashing

Racking System 1 Model Number: INPUT

UNIRAC SOLARMOUNT LIGHT  
RAIL

Datasheet for Racking System 1 [90.7 ; 110.3(C) ; R106.1](ensure your datasheet has the list of approved modules to 2703 for grounding and bonding): See attached.

1625151942184-115-UNIRAC\_R  
OOFMOUNT\_RM10.pdf

Racking System 1 Manufacturer: INPUT

unirac

Is Racking System 1 UL 2703 listed for grounding and bonding with the PV module models specified in this SolarAPP project? [90.7 ; 110.3(C) ; 690.43(A)]: YES

Yes

The combination of modules and racking system shall have the same fire classification as the roof assembly. R324.4.2: YES

Yes

Name/description of roof penetration sealant method to be used.

Geocell + Mechanical Flashing

You have agreed to install the flashing per the manufacturers instructions for the means of accomplishing weather proofing: YES.

Yes

## Rapid Shutdown

The AC module, microinverter, or DCDC converter installed on each module is listed for UL 1741 or UL 3741 as PVRSS or PVRSE and used to comply with requirements for Rapid Shutdown both inside and outside the array.[690.12(B)(2)(2)]

## Site Conditions

Ambient Dry Bulb Extreme Record Low Temperature (°C) [690.7(A)]: INPUT

1 °C

Ambient Dry Bulb Average High Temperature (°C): INPUT

42 °C

Single Phase Grid Voltage

240 V

## Installation Details

Is there an existing Utility interactive power production source connected to the home's electric service? NO	No
Are DC and AC conductors copper, Class B or Class C, and THWN-2, NM, USE-2, PV Wire, or jacketed multiconductor cable assembly listed and identified for the application? [690.8(B) ; 310.15(A) and (B)]: YES	Yes
NM cable is used for inverter output circuits and installed in locations and uses according to the Code [334.10]	No
Are all rooftop conduits mounted at least 7/8" above the roof surface.[310.15(B)(3)(c)]:[310.15(B)(2)]	Yes
Are all PV Source Circuit conductors installed without raceway listed as PV Wire or USE-2?: [690.31(C)]:[690.31(C)(1)]	Yes
Are all power terminals rated to 75°C, labeled for use with Copper Class B or Class C wires, and accept minimum 8 AWG wire?[110.14]	Yes
Where Equipment Grounding Conductors (EGC) are not routed with circuit conductors, EGC is a minimum of 6 AWG or is protected from physical damage [250.120(C)]	Yes
DC strings EGC is a minimum of 10 AWG	Yes
Module voltage and current DC specifications fall within allowable range of connected equipment: YES	Yes
All ancillary equipment is listed for the application, rated equal to or greater than the connected overcurrent device and installed per the manufacturer's instructions. Documentation shall be provided upon request.	Yes

**String Inverter with DC-DC Converters [690.7(B)]**

Maximum PV Source Circuit Voltage	
Does the quantity of series connected DC-DC converters exceed the manufacturers instructions to ensure a maximum string voltage of 600V? NO	No
Max quantity modules in DC series string: INPUT	16 modules
Datasheet for DCDC converter See attached.	1622137736049-I70-SE_OPTIMI ZER_DATA_SHEET.pdf

## PV Source Circuit

See Table 6 for selection of the minimum DC wire size.

Input maximum number of current carrying PV Wire or USE-2 conductors in raceway INPUT

0

Input maximum number of current carrying THWN-2 conductors in raceway INPUT

4

The minimum DC THWN-2 wire size is based on the Table 6 below.

12AWG

**Table 6**

Current Carrying Conductors (CCC) in raceway	Site Average High Temperature	2 series strings in parallel	Single series string
<=3 CCC	=< 35	10 AWG	12 AWG
	=< 40	10 AWG	12 AWG
	=< 45	10 AWG	12 AWG
	=< 50	10 AWG	12 AWG
4 - 6 CCC	=< 35	10 AWG	12 AWG
	=< 40	8 AWG	12 AWG
	=< 45	8 AWG	12 AWG
	=< 50	8 AWG	12 AWG
7 - 9 CCC	=< 35	8 AWG	12 AWG
	=< 40	8 AWG	12 AWG
	=< 45	8 AWG	12 AWG
	=< 50	8 AWG	12 AWG

[Table 310.15(B)(3)(a) ; Table 310.15(B)(2)(b) ; Table 310.15(B)(16) ; 690.8(A)(1) ; 690.8(B)]

## Inverter Output Circuit

See Table 3 below for selection of minimum Inverter output wire size and inverter output overcurrent protection size.

Inverter 1: Inverter Continuous Output Current = Power / Site Voltage: (118 →  
 INV:CEC:K:["Maximum Continuous Output Power at Unity Power Factor"]) W / C14  
 V = C5 A

31.73 A

## Inverter Output Circuit

**Table 3**

Table 3

Continuous Output Current	12.5	16.5	20.5	24.5	28.5	32.5	36.5	40.5	48.5	56.5	64.5	72.5	80.5	88.5	100.5	120.5	140.5	160.5
OCPD amperage size	15	20	25	30	35	40	45	50	60	70	80	90	100	110	125	150	175	200
AWG wire size for <=3 CCC in raceway	12	12	10	10	8	8	8	8	6	4	4	3	3	2	1	1/0	2/0	3/0
AWG wire size for 4 - 6 CCC in raceway	12	12	10	10	8	8	8	8	6	4	4	3	3	2	1	1/0	2/0	3/0
AWG wire size for 7 - 9 CCC in raceway	12	12	10	10	8	8	8	6	6	4	4	3	3	2	1	2/0	3/0	4/0
NM wire	12	12	10	10	8	8	6	6	4	4	3	2	1	1	1/0	N/A	N/A	N/A

[240.4(D); Table 310.15(B)(3)(a) ; Table 310.15(B)(2)(b) ; Table 310.15(B)(16) ; 690.8; 690.9; 705.30]

Inverter 1 - See Table 3 for the minimum Overcurrent Protection Device rating.[690.9(A) ; 690.9(B)]

40 AMP

Inverter 1 Overcurrent Protection Device rating [NEC 690.9(A); 690.9(B)]

60 A

Input maximum number of AC current carrying THHN-2 conductors in raceway: INPUT

4

Inverter 1 - See Table 3for selection of the AC wire size in raceway

6AWG

## Grounding & Bonding

See Table 5 for selection of Equipment Grounding Conductor wire gauge.

Inverter 1 - Equipment Grounding Conductor (EGC) based on overcurrent protective device:

10 AWG

**Table 5**

Table 5

OCPD rating (amperes)	EGC wire gauge (AWG)
=< 15	14
=< 20	12
=< 30	10
=< 40	10
=< 60	10
=< 100	8
=< 200	6

[Table 250.122]

## String Inverter with DC-DC Converters

### Maximum PV Source Circuit Voltage

DC-DC converter Manufacturer:

Solaredge

DC-DC converter Model Number:

P401

Module open circuit voltage is below the DC-DC converter maximum DC input voltage. The maximum DC input voltage for the equipment in question is

60 V

Module short circuit current is below the DC-DC converter maximum DC input current. The maximum DC input current for the equipment in question is

11.75 A

### PV Source Circuit

PV module series strings from solar arrays to the PV inverter are connected in parallel

No

### New Panelboard for Relocated Loads

Will a new subpanel be installed with existing loads relocated into the new subpanel?

No

### Equipment Point of Interconnection

#### Point of Connection

125% of the sum of power production sources continuous output current.

40 A

At the time of inspection, it will be verified that if connected equipment is NOT within line of sight or closer than 10ft to the point of interconnection, disconnect or isolation means are installed.[NEC 690.15 (A)]

### Point of Connection at Subpanel

#### Existing Subpanel

Will power production inverter outputs be connected directly to an existing subpanel?  
\_\_\_\_ (175) \_\_\_\_

No

### Point of Connection at Main Panel

## System Point of Interconnection Compliance Method at MSP

INPUT	705.12 (B) (2) (3) (b)
-------	------------------------

## Main Service Panel Equipment

Main Bus Ampere Rating: INPUT AMP	200 A
-----------------------------------	-------

Main Breaker/Service Disconnect Ampere Rating: INPUT AMP	200 A
--	-------

Since no connection was indicated at a subpanel or at a subpanel feeder, power production sources are connected either directly to the main service panel or in a Supply Side Connection:

## Point of Connection

### Main Service Panel Equipment

What is the Utility service feed rated for (INPUT amp)	200 AMP
--	---------

## Point of Connection at Subpanel Feeders

### Load Side Tap

Power production sources are connected to a subpanel feeder. A subpanel feeder connection, may be a connection directly to a conductor, or using lug terminations in equipment such as an Microgrid Interconnection Device (MID).	No
---	----

## Electrical Work

### Main Panel Upgrades and Main Breaker Derates

A Main Panel Upgrade is being performed.	No
--	----

A Main Breaker Derate is being performed.	No
---	----

## Interconnection at Main Service Panel

Where two sources, one a primary power source and the other another power source, are located at opposite ends of a busbar that contains loads, the sum of 125 percent of the power source(s) output circuit current and the rating of the overcurrent device protecting the busbar shall not exceed 120 percent of the ampacity of the busbar. Enter the service disconnect ampere rating \_\_\_\_ (I39) \_\_\_\_ A Enter the main bus ampere rating \_\_\_\_ (I38) \_\_\_\_ A Enter the sum of power production source overcurrent protective device ampere rating \_\_\_\_ C8 \_\_\_\_ A (calculated from architecture specific design section above) Since  $(I38 * 120\%) - I39 \geq C8$ , then YES Compatible with SolarAPP

Yes

## WORKERS' COMP

By applying for this permit, you represent and warrant that you have (and will have during the performance of the work) all valid approvals, certifications, and licenses required for the performance of the work for which this permit is issued, (ii) carry (and will carry during the performance of the work) all necessary insurance required by law or governmental authority in the jurisdiction and (iii) will comply with all applicable laws required in the performance of the work.

SAMPLE



**System**

New Rooftop Residential Retrofit PV Systems

Installed by contractor with all licenses required by jurisdiction

**Electrical**

Limited to 2017 NEC

600V Max per DC System Size

Single phase only

No Aluminum Wires

Must Use 600V rated PV wire (due to outer diameter &gt; 0.24" (6.1mm))

Must use 90 deg C rated insulated wire

Max 2 DC strings in parallel

Max 9 current carrying conductors in a raceway

Inverter output circuit conductors must be THWN-2, or listed NM

Terminals must be rated to 75 deg C, labeled for use with Cu wires, and accept minimum 8 AWG wire

If using microinverter, 1 module per microinverter

Permitted to install on up to or equal to 400A Service

Permitted to install on up to or equal to 225A Service Disconnect

Permitted to install on up to or equal to 225A busbars

No existing PV or ESS

May install only 1 module type

May install up to 2 Inverters for String Inverters, up to 1 inverter type for Micro-inverters and AC modules Systems

Conduit may not be Schedule 80 PVC

Single Family Dwelling Only

Modules and Inverters must be listed on CEC

Rapid Shutdown cannot be satisfied using the method: No exposed wiring or conductive parts [690.12(B)(2)(3)]

No trenching allowed

All power production inverter outputs have the same point of connection

All equipment is assumed to be non-continuous rated

May install only 1 racking system type

Height of rooftop conduit &gt; = 7/8"

Flat Plate PV Modules Only

**Structural**

Applicable International Residential Code

PV system + hardware weight is less than or equal to 4psf

No ground mounted systems

No carports or non-permanent structures


No wood shake or wood shingle roofing

Limit of 10" above the roof for pitched (&gt;2/12) roof systems

No metal roof or low-slope roof in areas with &gt; 15psf snow load

**Fire**

Applicable International Residential Code




## LR4-60HPB 345~365M

NEW

Hi-MO 4m

**High Efficiency**  
**Low LID Mono PERC with**  
**Half-cut Technology**

10-year Warranty for Materials and Processing;  
25-year Warranty for Extra Linear Power Output

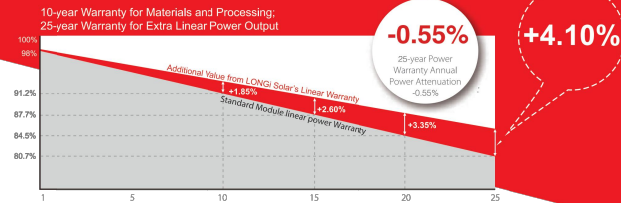

**Complete System and Product Certifications**

IEC 61215, IEC61730, UK61730  
ISO 9001:2008: ISO Quality Management System  
ISO 14001:2004: ISO Environment Management System  
TS62941: Guideline for module design qualification and type approval  
OHSA5 18001: 2007 Occupational Health and Safety



\* Specifications subject to technical changes and tests. LONGi Solar reserves the right of interpretation.

Positive power tolerance (0~+5W) guaranteed

High module conversion efficiency (up to 20%)

Slower power degradation enabled by Low LID Mono PERC technology: first year <2%, 0.55% year 2-25

Solid PID resistance ensured by solar cell process optimization and careful module BOM selection

Reduced resistive loss with lower operating current

Higher energy yield with lower operating temperature

Reduced hot spot risk with optimized electrical design and lower operating current




Room 801, Tower 3, Lujiazui Financial Plaza, No.826 Century Avenue, Pudong Shanghai, 200120, China  
Tel: +86-21-95162606 Email: module@longi-silicon.com Facebook: www.facebook.com/LONGiSolar

Note: Due to continuous technical innovation, R&D and improvement, technical data above mentioned may be of modification accordingly. LONGi have the sole right to make such modification at any time without further notice. Demanding party shall request for the latest datasheet for such as contract need, and make it a consisting and binding part of lawful documentation duly signed by both parties.

20200105-Draft

## LR4-60HPB 345~365M

**Design (mm)**



**Mechanical Parameters**

Cell Orientation: L10 (6-20)  
Junction Box: IP68, three diodes  
Output Cable: 4mm<sup>2</sup>, 300mm in length, length can be customized  
Glass: Single glass  
3.2mm coated tempered glass  
Frame: Anodized aluminum alloy frame  
Weight: 25.5kg  
Dimensions: 1755x1038x35mm  
Packaging: 50pcs per pallet  
180pcs per 20'GP  
780pcs per 40'HC

**Operating Parameters**

Operational Temperature: -40°C ~ +85°C  
Power Output Tolerance: 0~+5 W  
Voc and Isc Tolerance: ±3%  
Maximum System Voltage: DC1000V (IEC/UL)  
Maximum Series Fuse Rating: 20A  
Nominal Operating Cell Temperature: 45±2°C  
Safety Class: Class II  
Fire Rating: UL type 1 or 2


**Electrical Characteristics** Tc: uncertainty for Pmax ±3%

Model Number	LR4-60HPB-345M		LR4-60HPB-350M		LR4-60HPB-355M		LR4-60HPB-360M		LR4-60HPB-365M	
	STC	NOCT	STC	NOCT	STC	NOCT	STC	NOCT	STC	NOCT
Maximum Power (Pmax/W)	345	255.6	350	259.3	355	263.0	360	266.7	365	270.4
Open Circuit Voltage (Voc/V)	40.2	37.5	40.4	37.7	40.6	37.9	40.8	38.1	41.0	38.3
Short Circuit Current (Isc/A)	11.06	8.92	11.16	8.99	11.25	9.06	11.33	9.13	11.41	9.20
Voltage at Maximum Power (Vmp/V)	34.2	31.6	34.4	31.8	34.6	32.0	34.8	32.1	35.0	32.3
Current at Maximum Power (Imp/A)	10.09	8.09	10.18	8.16	10.27	8.23	10.35	8.30	10.43	8.36
Module Efficiency (%)	18.9	19.2	19.2	19.5	19.5	19.8	19.8	19.8	20.0	20.0

STC (Standard Testing Conditions): Irradiance 1000W/m<sup>2</sup>, Cell Temperature 25°C, Spectra at AM1.5  
NOCT (Nominal Operating Cell Temperature): Irradiance 800W/m<sup>2</sup>, Ambient Temperature 20°C, Spectra at AM1.5, Wind at 1m/s

**Temperature Ratings (STC)** **Mechanical Loading**

Temperature Coefficient of Isc	+0.057%/C	Front Side Maximum Static Loading	5400Pa
Temperature Coefficient of Voc	-0.286%/C	Rear Side Maximum Static Loading	2400Pa
Temperature Coefficient of Pmax	-0.370%/C	Hallstone Test	25mm Hallstone at the speed of 23m/s

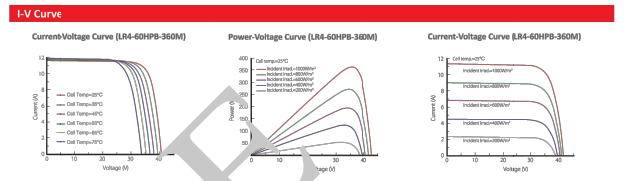

Room 801, Tower 3, Lujiazui Financial Plaza, No.826 Century Avenue, Pudong Shanghai, 200120, China  
Tel: +86-21-95162606 Email: module@longi-silicon.com Facebook: www.facebook.com/LONGiSolar

Note: Due to continuous technical innovation, R&D and improvement, technical data above mentioned may be of modification accordingly. LONGi have the sole right to make such modification at any time without further notice. Demanding party shall request for the latest datasheet for such as contract need, and make it a consisting and binding part of lawful documentation duly signed by both parties.

20200105-Draft


SAMPLE

# ROOFMOUNT | RM10

SOUTH FACING 10 DEGREE TILT



**RM10** introduced the Power of Speed & Simplicity to the ballasted flat roof solar industry. The system consists of only two major components, minimizing installation time. Quickly design around roof obstacles and bond the system with just the turn of a wrench. Optional roof attachments, roof pads, and MLPE mount provide a complete solution UNIRAC's unmatched commercial project support makes construction easy, from permitting through installation, and **RM10** is supported by North America's largest distribution network. Plus, enjoy peace of mind with UNIRAC's industry-leading 25-year warranty.

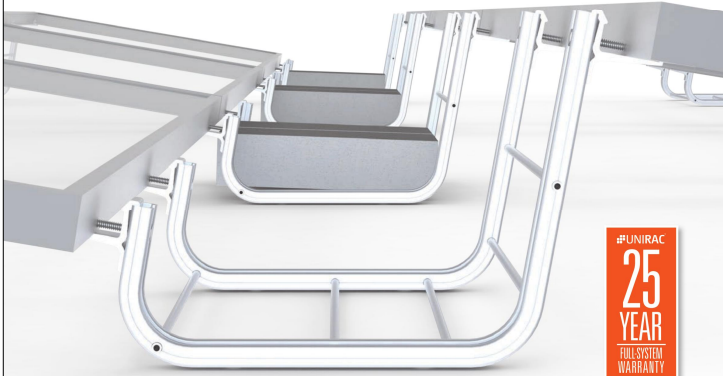

## FEWER PARTS • FASTER INSTALLATION

FOR QUESTIONS OR CUSTOMER SERVICE VISIT [UNIRAC.COM](http://UNIRAC.COM) OR CALL (505) 248-2702

# ROOFMOUNT | RM10


SOUTH FACING 10 DEGREE TILT



### SIMPLE DESIGN

#### TWO MAJOR COMPONENTS. ONE TOOL

**RM10** supports most framed PV modules at 10 degree tilt. The component list consists of only two major components – a fully assembled ballast bay and a universal module clip. Our engineers specified a chemical locking hex bolt, providing a UL2703 certified grounding path from module to ballast bay, with just the turn of a wrench. **RM** is designed to conveniently work with off the shelf wire management products. A snap into place, membrane-friendly, rubber roof pad is also available as a low-cost option for roof protection.




INTEGRATED BONDING CLIP

### AVAILABILITY

#### NATIONWIDE NETWORK

UNIRAC maintains the largest network of stocking distributors for our racking solutions. Our partners have distinguished their level of customer support, availability, and overall value, thereby providing the highest level of service to users of UNIRAC products. Count on our partners for fast and accurate delivery to meet your project needs. Visit [unirac.com](http://unirac.com) for a list of distributors.




### AUTOMATED DESIGN TOOL

#### DESIGN PLATFORM AT YOUR SERVICE

Creating a bill of materials is just a few clicks away with **U-Builder**, a powerful online tool that streamlines the process of designing a code compliant solar mounting system. Save time by creating a user profile, and recall preferences and projects automatically when you log in. You will enjoy the ability to share projects with customers; there's no need to print results and send to a distributor, just click and share.

OPTIONAL ROOF PAD



**LISTED** **UL2703** BONDING & GROUNDING MECHANICAL LOADING SYSTEM FIRE CLASSIFICATION

### UNIRAC CUSTOMER SERVICE MEANS THE HIGHEST LEVEL OF PRODUCT SUPPORT



#### TECHNICAL SUPPORT

UNIRAC's technical support team is dedicated to answering questions & addressing issues in real time. An online library of documents including engineering reports, stamped letters and technical sheets greatly simplifies your permitting and proposal process.

#### QUALITY PROVIDER

UNIRAC is the only PV mounting vendor with ISO certification for 9001:2015, 14001:2015 and OHSAS 18001:2007. These certifications demonstrate our excellence and commitment to first class business practices.

#### BANKABLE WARRANTY

Don't leave your project to chance. UNIRAC has the financial strength to back our products and reduce your risk. Have peace of mind knowing you are receiving products of exceptional quality. **ROOFMOUNT** is covered by a twenty five (25) year limited product warranty.

PROTECT YOUR INVESTMENT WITH SAFETY RACKING SOLUTIONS BACKED BY ENGINEERING EXCELLENCE AND A SUPERIOR SUPPLY CHAIN

SAMPLE

# Power Optimizer

For North America

P320 / P340 / P370 / P400 / P401 / P405 / P485 / P505



POWER OPTIMIZER

## PV power optimization at the module-level

- Specifically designed to work with SolarEdge inverters
- Up to 25% more energy
- Superior efficiency (99.5%)
- Mitigates all types of module mismatch losses, from manufacturing tolerance to partial shading
- Flexible system design for maximum space utilization
- Fast installation with a single bolt
- Next generation maintenance with module-level monitoring
- Meets NEC requirements for arc fault protection (AFCI) and Photovoltaic Rapid Shutdown System (PVRSS)
- Module-level voltage shutdown for installer and firefighter safety

solaredge.com



## Power Optimizer

For North America

P320 / P340 / P370 / P400 / P401 / P405 / P485 / P505

Optimizer model (typical module compatibility)	P320 (for 60-cell modules)	P340 (for high-power 60-cell modules)	P370 (for high-power 60 and 72-cell modules)	P400 (for 72 & 96-cell modules)	P401 (for high-power 60 and 72 cell modules)	P405 (for high-voltage modules)	P485 (for high-voltage modules)	P505 (for higher current modules)		
<b>INPUT</b>										
Rated Input DC Power <sup>(1)</sup>	320	340	370	400	405	485	505	W		
Absolute Maximum Input Voltage (Voc at lowest temperature)	48	60	80	60	125 <sup>(2)</sup>	83 <sup>(3)</sup>	Vdc			
MPI <sup>(4)</sup> Operating Range	8 - 48	8 - 60	8 - 80	8 - 80	12.5 - 105	12.5 - 83	Vdc			
Maximum Short Circuit Current (IsC)	11	10.1	11.75	11	14	Adc				
Maximum Efficiency	99.5								%	
Weighted Efficiency	98.8								%	
Overvoltage Category	II									
<b>OUTPUT DURING OPERATION (POWER OPTIMIZER CONNECTED TO OPERATING SOLAREDGE INVERTER)</b>										
Maximum Output Current	15								Adc	
Maximum Output Voltage	60								85	Vdc
<b>OUTPUT DURING STANDBY (POWER OPTIMIZER DISCONNECTED FROM SOLAREDGE INVERTER OR SOLAREDGE INVERTER OFF)</b>										
Safety Output Voltage per Power Optimizer	1 ± 0.1								Vdc	
<b>STANDARD COMPLIANCE</b>										
EMC	FCC Part 15 Class B, IEC61000-6-2, IEC61000-6-3									
Safety	IEC62109-1 (class II safety), UL1741									
Material	UL94 V-0, UV Resistant									
RoHS	Yes									
<b>INSTALLATION SPECIFICATIONS</b>										
Maximum Allowed System Voltage	1000								Vdc	
Compatible Inverters	All SolarEdge Single Phase and Three Phase Inverters									
Dimensions (W x L x H)	129 x 153 x 27.5 / 5.1 x 6 x 1.1	129 x 153 x 33.5 / 5.1 x 6 x 1.3	129 x 153 x 29.5 / 5.1 x 6 x 1.16	129 x 159 x 49.5 / 5.1 x 6.3 x 1.9	129 x 162 x 59 / 5.1 x 6.4 x 2.3	mm / in.				
Weight (including cables)	630 / 1.4	750 / 1.7	655 / 1.5	845 / 1.9	1064 / 2.3	gr / lb				
Input Connector	MC4 <sup>(5)</sup>			Single or dual MC4 <sup>(6)</sup>		MC4 <sup>(7)</sup>				
Input Wire Length	0.16 / 0.52								m / ft	
Output Wire Type / Connector	Double Insulated / MC4									
Output Wire Length	0.9 / 2.95	1.2 / 3.9							m / ft	
Operating Temperature Range <sup>(8)</sup>	-40 ~ +85 / -40 ~ +185								°C / °F	
Protection Rating	IP68 / NEMA6P									
Relative Humidity	0 - 100								%	

(1) Rated power of the module at STC will not exceed the optimizer "Rated Input DC Power". Modules with up to +5% power tolerance are allowed.  
 (2) NEC 2017 requires max input voltage be not more than 60V.  
 (3) For other connector types please contact SolarEdge.  
 (4) For dual version for parallel connection of two modules use P485-4NMDMM. In the case of an odd number of PV modules in one string, installing one P485 dual version power optimizer connected to one PV module. When connecting a single module use the unused input connector with the supplied pair of nuts.  
 (5) For ambient temperature above +85°C / +185°F power de-rating is applied. Refer to Power Optimizers Temperature De-Rating Technical Note for more details.

PV System Design Using a SolarEdge Inverter	Single Phase HD-Wa	Single phase	Three Phase for 208V grid	Three Phase for 277/480V grid
Minimum String Length (Power Optimizers)	8	8	10	18
Maximum String Length (Power Optimizers)	6	25	8	16
Maximum Power per String	600 with SE760 / \$11400	5250	6000 <sup>(9)</sup>	12750 <sup>(9)</sup>
Parallel Strings of Different Length or Orientations	Yes			

(6) For detailed string sizing information see <http://www.solaredge.com/files/464/476/1292/9489/P320/P400/P401/P405/P485/P505/16-string-parallel-string-sizing-2017-08-16.pdf>  
 (7) It is not allowed to mix MC4 and MC4+ connectors in the same string.  
 (8) For strings with more than 30 optimizers, the maximum string length must meet NEC rapid shutdown requirements. Safety voltage will be above the 30V requirement for strings with more than 30 optimizers. Power difference between each string is 100W.  
 (9) For 208V grid, it is allowed to install up to 100W per string when the maximum power difference between each string is 2,000W.

© SolarEdge Technologies Ltd. All Rights Reserved. SolarEdge and SOLAREDGE are trademarks or registered trademarks of SolarEdge Technologies, Inc. in the United States and other countries. All other trademarks are the property of their respective owners. Form ID: 01/2016 VCS/RS/NAK. Subject to change without notice.



SAMPLE

# Single Phase Inverter with HD-Wave Technology

for North America

SE3000H-US / SE3800H-US / SE5000H-US / SE6000H-US / SE7600H-US / SE10000H-US / SE11400H-US



12-25 YEAR WARRANTY

INVERTERS

## Optimized installation with HD-Wave technology

- Specifically designed to work with power optimizers
- Record breaking efficiency
- Fixed voltage inverter for longer strings
- Integrated arc fault protection and rapid shutdown for NEC 2014 and 2017, per article 690.11 and 690.12
- UL1741 SA certified, for CPUC Rule 21 grid compliance
- Extremely small
- Built-in module-level monitoring
- Outdoor and indoor installation
- Optional: Revenue grade data, ANSI C12.20 Class 0.5 (0.5% accuracy)

solaredge.com



## Single Phase Inverter with HD-Wave Technology for North America

SE3000H-US / SE3800H-US / SE5000H-US / SE6000H-US / SE7600H-US / SE10000H-US / SE11400H-US

	SE3000H-US	SE3800H-US	SE5000H-US	SE6000H-US	SE7600H-US	SE10000H-US	SE11400H-US		
<b>OUTPUT</b>									
Rated AC Power Output	3000	3800 @ 240V / 3300 @ 208V	5000	6000 @ 240V / 5000 @ 208V	7600	10000	11400 @ 240V / 10000 @ 208V	VA	
Maximum AC Power Output	3000	3800 @ 240V / 3300 @ 208V	5000	6000 @ 240V / 5000 @ 208V	7600	10000	11400 @ 240V / 10000 @ 208V	VA	
AC Output Voltage Min.-Nom.-Max. (211 - 240 - 254)	✓	✓	✓	✓	✓	✓	✓	Vac	
AC Output Voltage Min.-Nom.-Max. (183 - 208 - 229)	-	✓	-	✓	-	-	✓	Vac	
AC Frequency (Nominal)	59.3 - 60 - 60.5 <sup>1)</sup>								Hz
Maximum Continuous Output Current @240V	12.5	16	21	25	32	42	47.5	A	
Maximum Continuous Output Current @208V	-	16	-	-	-	-	48.5	A	
Grid Threshold	1								A
Utility Monitoring: Islanding Protection, Country Configurable Thresholds	Yes								
<b>INPUT</b>									
Maximum DC Power @240V	4650	5900	7750	9300	11800	15500	17650	W	
Maximum DC Power @208V	-	5100	-	7750	-	-	15500	W	
Transformer-less, Ungrounded	Yes								
Maximum Input Voltage	480								Vac
Nominal DC Input Voltage	380								Vac
Maximum Input Current @240V <sup>2)</sup>	8.5	10.5	13.5	16.5	20	27	30.5	Adc	
Maximum Input Current @208V <sup>3)</sup>	-	9	-	13.5	-	-	27	Adc	
Max. Input Short Circuit Current	45								Adc
Reverse-Polarity Protection	Yes								
Island-Isolation Detection	60kV sensitivity								
Maximum Inverter Efficiency	99				99.2			%	
CEC Weighted Efficiency			99				99 @ 240V / 98.5 @ 208V	%	
Nighttime Power Consumption	< 2.5								W
<b>ADDITIONAL FEATURES</b>									
Supported Communication Interfaces	RS485, Ethernet, ZigBee (optional), Cellular (optional)								
Revenue Grade Data, ANSI C12.20	Optional <sup>4)</sup>								
Rapid Shutdown - NEC 2014 and 2017 690.12	Automatic Rapid Shutdown upon AC Grid Disconnect								
<b>STANDARD COMPLIANCE</b>									
Safety	UL1741, UL1741 SA, UL1699B, CSA C22.2, Canadian AFCI according to TLL M-07								
Grid Connection Standards	IEEE1547, Rule 21, Rule 14 (H)								
Emissions	FCC Part 15 Class B								
<b>INSTALLATION SPECIFICATIONS</b>									
AC Output Conduit Size / AWG Range	1" Maximum / 14-6 AWG				1" Maximum / 14-4 AWG				
DC Input Conduit Size / # of Strings / AWG Range	1.1" Maximum / 1-2 strings / 14-6 AWG				1" Maximum / 1-3 strings / 14-6 AWG				
Dimensions with Safety Switch (HxWxD)	17.7 x 14.6 x 8.8		/ 450 x 370 x 174		21.3 x 14.6 x 7.3		/ 540 x 370 x 185		in / mm
Weight with Safety Switch	22 / 10		lb / kg		26.2 / 11.9		38.8 / 17.6		lb / kg
Noise	< 25 dBA								
Cooling	Natural Convection								
Operating Temperature Range	-13 to +140 °F (-20 to +60°C) (-40°F / -40°C option) <sup>5)</sup>								°F / °C
Protection Rating	NEMA 4X (Inverter with Safety Switch)								

<sup>1)</sup> For other regional settings please contact SolarEdge support.  
<sup>2)</sup> A higher current source may be used the inverter will limit its input current to the values stated.  
<sup>3)</sup> Revenue grade inverter only. Contact your local distributor for more information.  
<sup>4)</sup> For power derating information refer to the optional revenue grade data sheet located at [solaredge.com/sites/default/files/2017-08/Optional%20revenue%20grade%20data%20sheet%20-%20derating%20note.pdf](https://solaredge.com/sites/default/files/2017-08/Optional%20revenue%20grade%20data%20sheet%20-%20derating%20note.pdf)  
<sup>5)</sup> -40 version P/N: SE3000H-US0000N14

© SolarEdge Technologies, Inc. All rights reserved. SOLAREDGE, the logo, OPTIMIZED BY SOLAR, and HD-WAVE are trademarks or registered trademarks of SolarEdge Technologies, Inc. All other trademarks mentioned herein are the property of their respective owners. ENEC019100151

RoHS

SAMPLE



Address: Intertek 3833 US 11  
 Corland NY 13045  
 Telephone: 607-758-6516  
 www.intertek.com

Subject: ETL Evaluation of SolarEdge Products to NEC 2017 Rapid Shutdown Requirements

To, whom it may concern

This letter represents the testing results of the below listed products to the requirements contained in the following standards:

- National Electric Code, 2017, Section 690.12 requirement for rapid shutdown.
- UL 1741, UL 1741 CRD for rapid shutdown

The evaluation was done on the PV Rapid Shutdown System (PVRSS), and covers installations consisting of optimizers and inverters with part numbers listed below.

The testing done has verified that controlled conductors are limited to:

- Not more than 30 volts and 240 voltamperes within 30 seconds of rapid shutdown initiation outside the array.
- Not more than 80 volts and 240 voltamperes within 30 seconds of rapid shutdown initiation inside the array.

The rapid shutdown initiation is performed by either disconnecting the AC feed to the inverter, or – if the inverter DC Safety switch is readily accessible – by turning off the DC Safety switch.

Applicable products:

- Power optimizers:
  - PB followed by 001 to 350; followed by -AOB or -TFI.
  - OP followed by 001 to 500; followed by -LV, -MV, -IV or -EV.
  - P followed by 001 to 850.
  - SP followed by 001 to 350.

\*When optimizers are connected to 2 or more modules in series, the max input voltage may exceed 80V. Following the implementation of the NEC 2017 rapid shutdown value of 80V max inside of the array at the beginning of 2019, modules exceeding this combined input max voltage will be required to use optimizers with parallel inputs.
- 1-ph Inverters:

This information is for the exclusive use of Intertek's Client and is provided pursuant to the agreement between Intertek and its Client. Intertek's responsibility and liability are limited to the terms and conditions of the agreement. Intertek assumes no liability to any party, other than to the Client in accordance with the agreement, for any loss, expense, or damage occasioned by the use of this information. Any observations and results in this report are relevant only to the sample evaluated. Only the Client is authorized to copy and distribute this information and only then in its entirety.

Version: 8-September-2016


Page 1 of 3

© 2018 Intertek  
 GFT-OP-10a



Address: Intertek 3833 US 11  
 Corland NY 13045  
 Telephone: 607-758-6516  
 www.intertek.com

- SE3000A-US / SE3800A-US / SE5000A-US / SE6000A-US / SE7600A-US / SE10000A-US / SE11400A-US / SE3000H-US / SE3800H-US / SE5000H-US / SE6000H-US / SE7600H-US / SE10000H-US / SE11400H-US when the following label is labeled on the side of the inverter:



Inverter part number may be followed by a suffix

- 3-ph Inverters:
  - SE9KUS / SE10KUS / SE14.4KUS / SE20KUS / SE30KUS / SE33.3KUS / SE43.2KUS / SE66.6KUS / SE100KUS ; when the following label is labeled on the side of the inverter:



Inverter part number may be followed by a suffix

If there are any questions regarding the results contained in this report, or any of the other services offered by Intertek, please do not hesitate to contact the undersigned.

This information is for the exclusive use of Intertek's Client and is provided pursuant to the agreement between Intertek and its Client. Intertek's responsibility and liability are limited to the terms and conditions of the agreement. Intertek assumes no liability to any party, other than to the Client in accordance with the agreement, for any loss, expense, or damage occasioned by the use of this information. Any observations and results in this report are relevant only to the sample evaluated. Only the Client is authorized to copy and distribute this information and only then in its entirety.

Version: 8-September-2016

Page 2 of 3

© 2018 Intertek  
 GFT-OP-10a

SAMPLE